



Draft Route Alignment

Section 1: Nant Mithil Energy Park to Aberedw Hill

— Section 1 Draft Alignment

● Section 1 Pole

Section 2: Aberedw Hill to Llangamarch Wells

— Section 2 Draft Alignment

— Section 2 Pylon

■ Switching Station


■ Previous Preferred Route Option

Other Energy Parks

■ Nant Mithil Energy Park

■ Aberedw Energy Park

■ Bryn Gilwern Energy Park

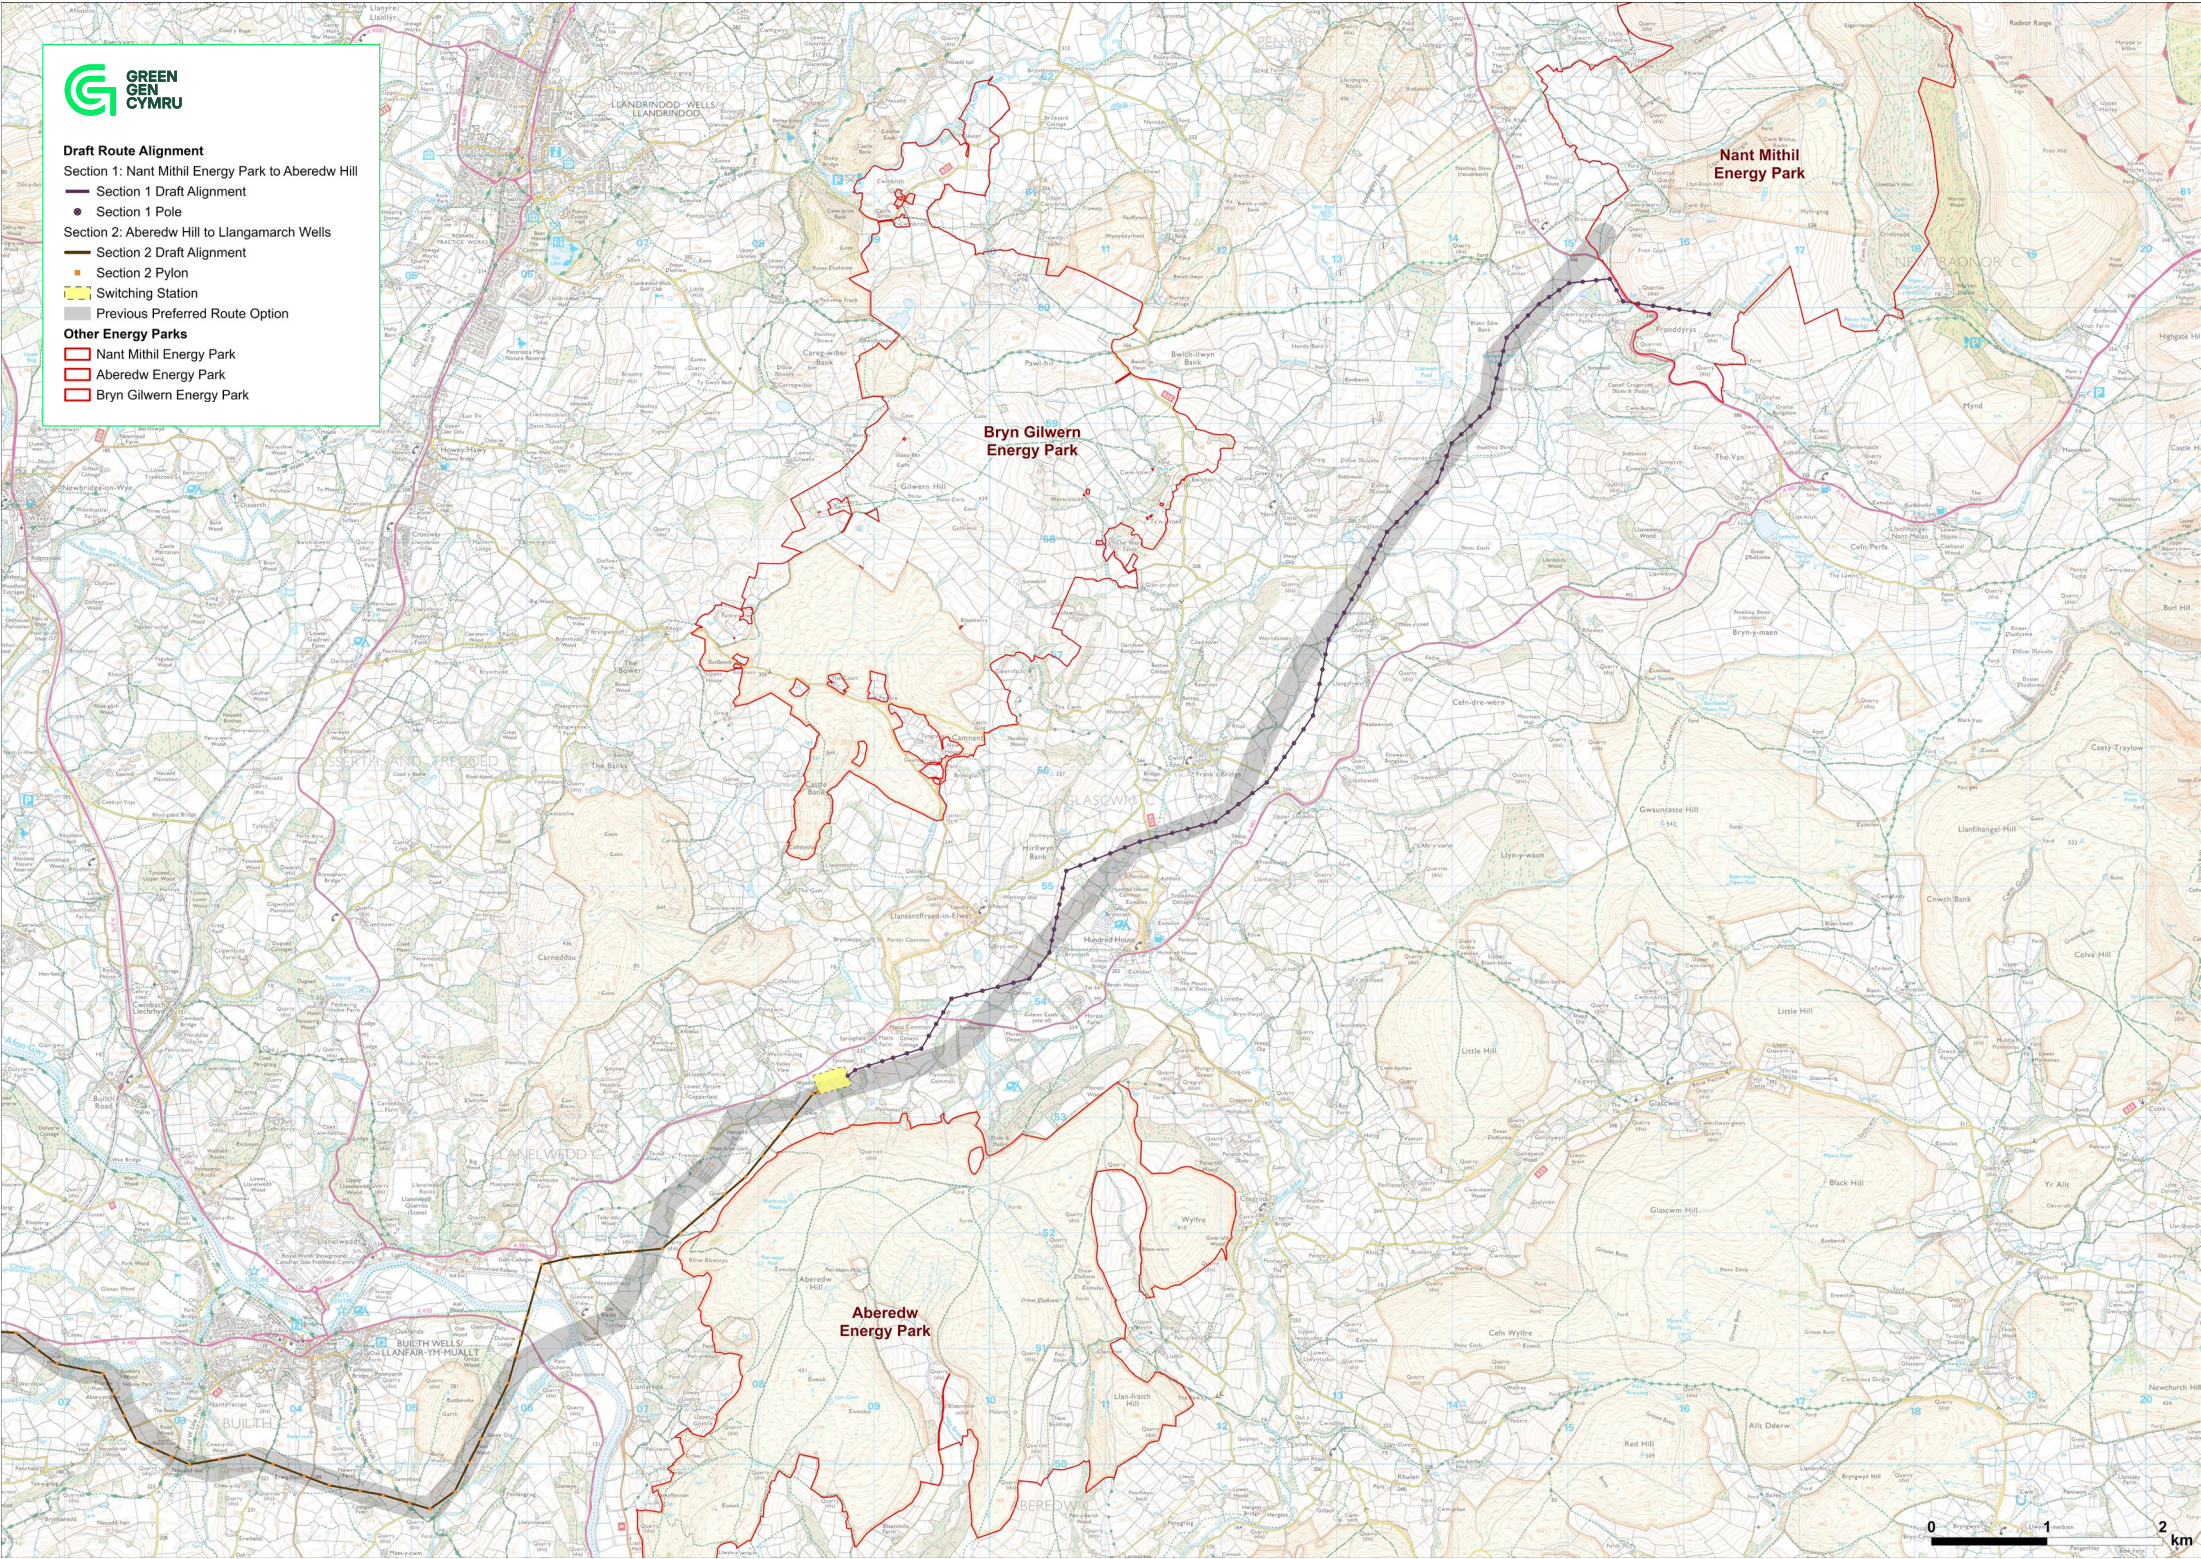



Draft Route Alignment
Section 1: Nant Mithil Energy Park to Aberedw Hill

— Section 1 Draft Alignment
● Section 1 Pole

Section 2: Aberedw Hill to Llangamarch Wells
— Section 2 Draft Alignment
● Section 2 Pylon

Section 3: Llangamarch Wells to Llandovery
— Section 3 Draft Alignment - Option A
■ Section 3 Pylon - Option A

■ Switching Station
■ Previous Preferred Route Option

Other Energy Parks
■ Aberedw Energy Park
■ Bryn Gilwern Energy Park

Bryn Gilwern Energy Park

Aberedw Energy Park





Draft Route Alignment

Section 2: Aberedw Hill to Llangamarch Wells

— Section 2 Draft Alignment

■ Section 2 Pylon

Section 3: Llangamarch Wells to Llandoverly

— Section 3 Draft Alignment - Option A

■ Section 3 Pylon - Option A

— Section 3 Draft Alignment - Option B


■ Section 3 Pylon - Option B

Section 4: Llandoverly to Llandeilo

— Section 4 Draft Alignment


■ Section 4 Pylon

■ Previous Preferred Route Option

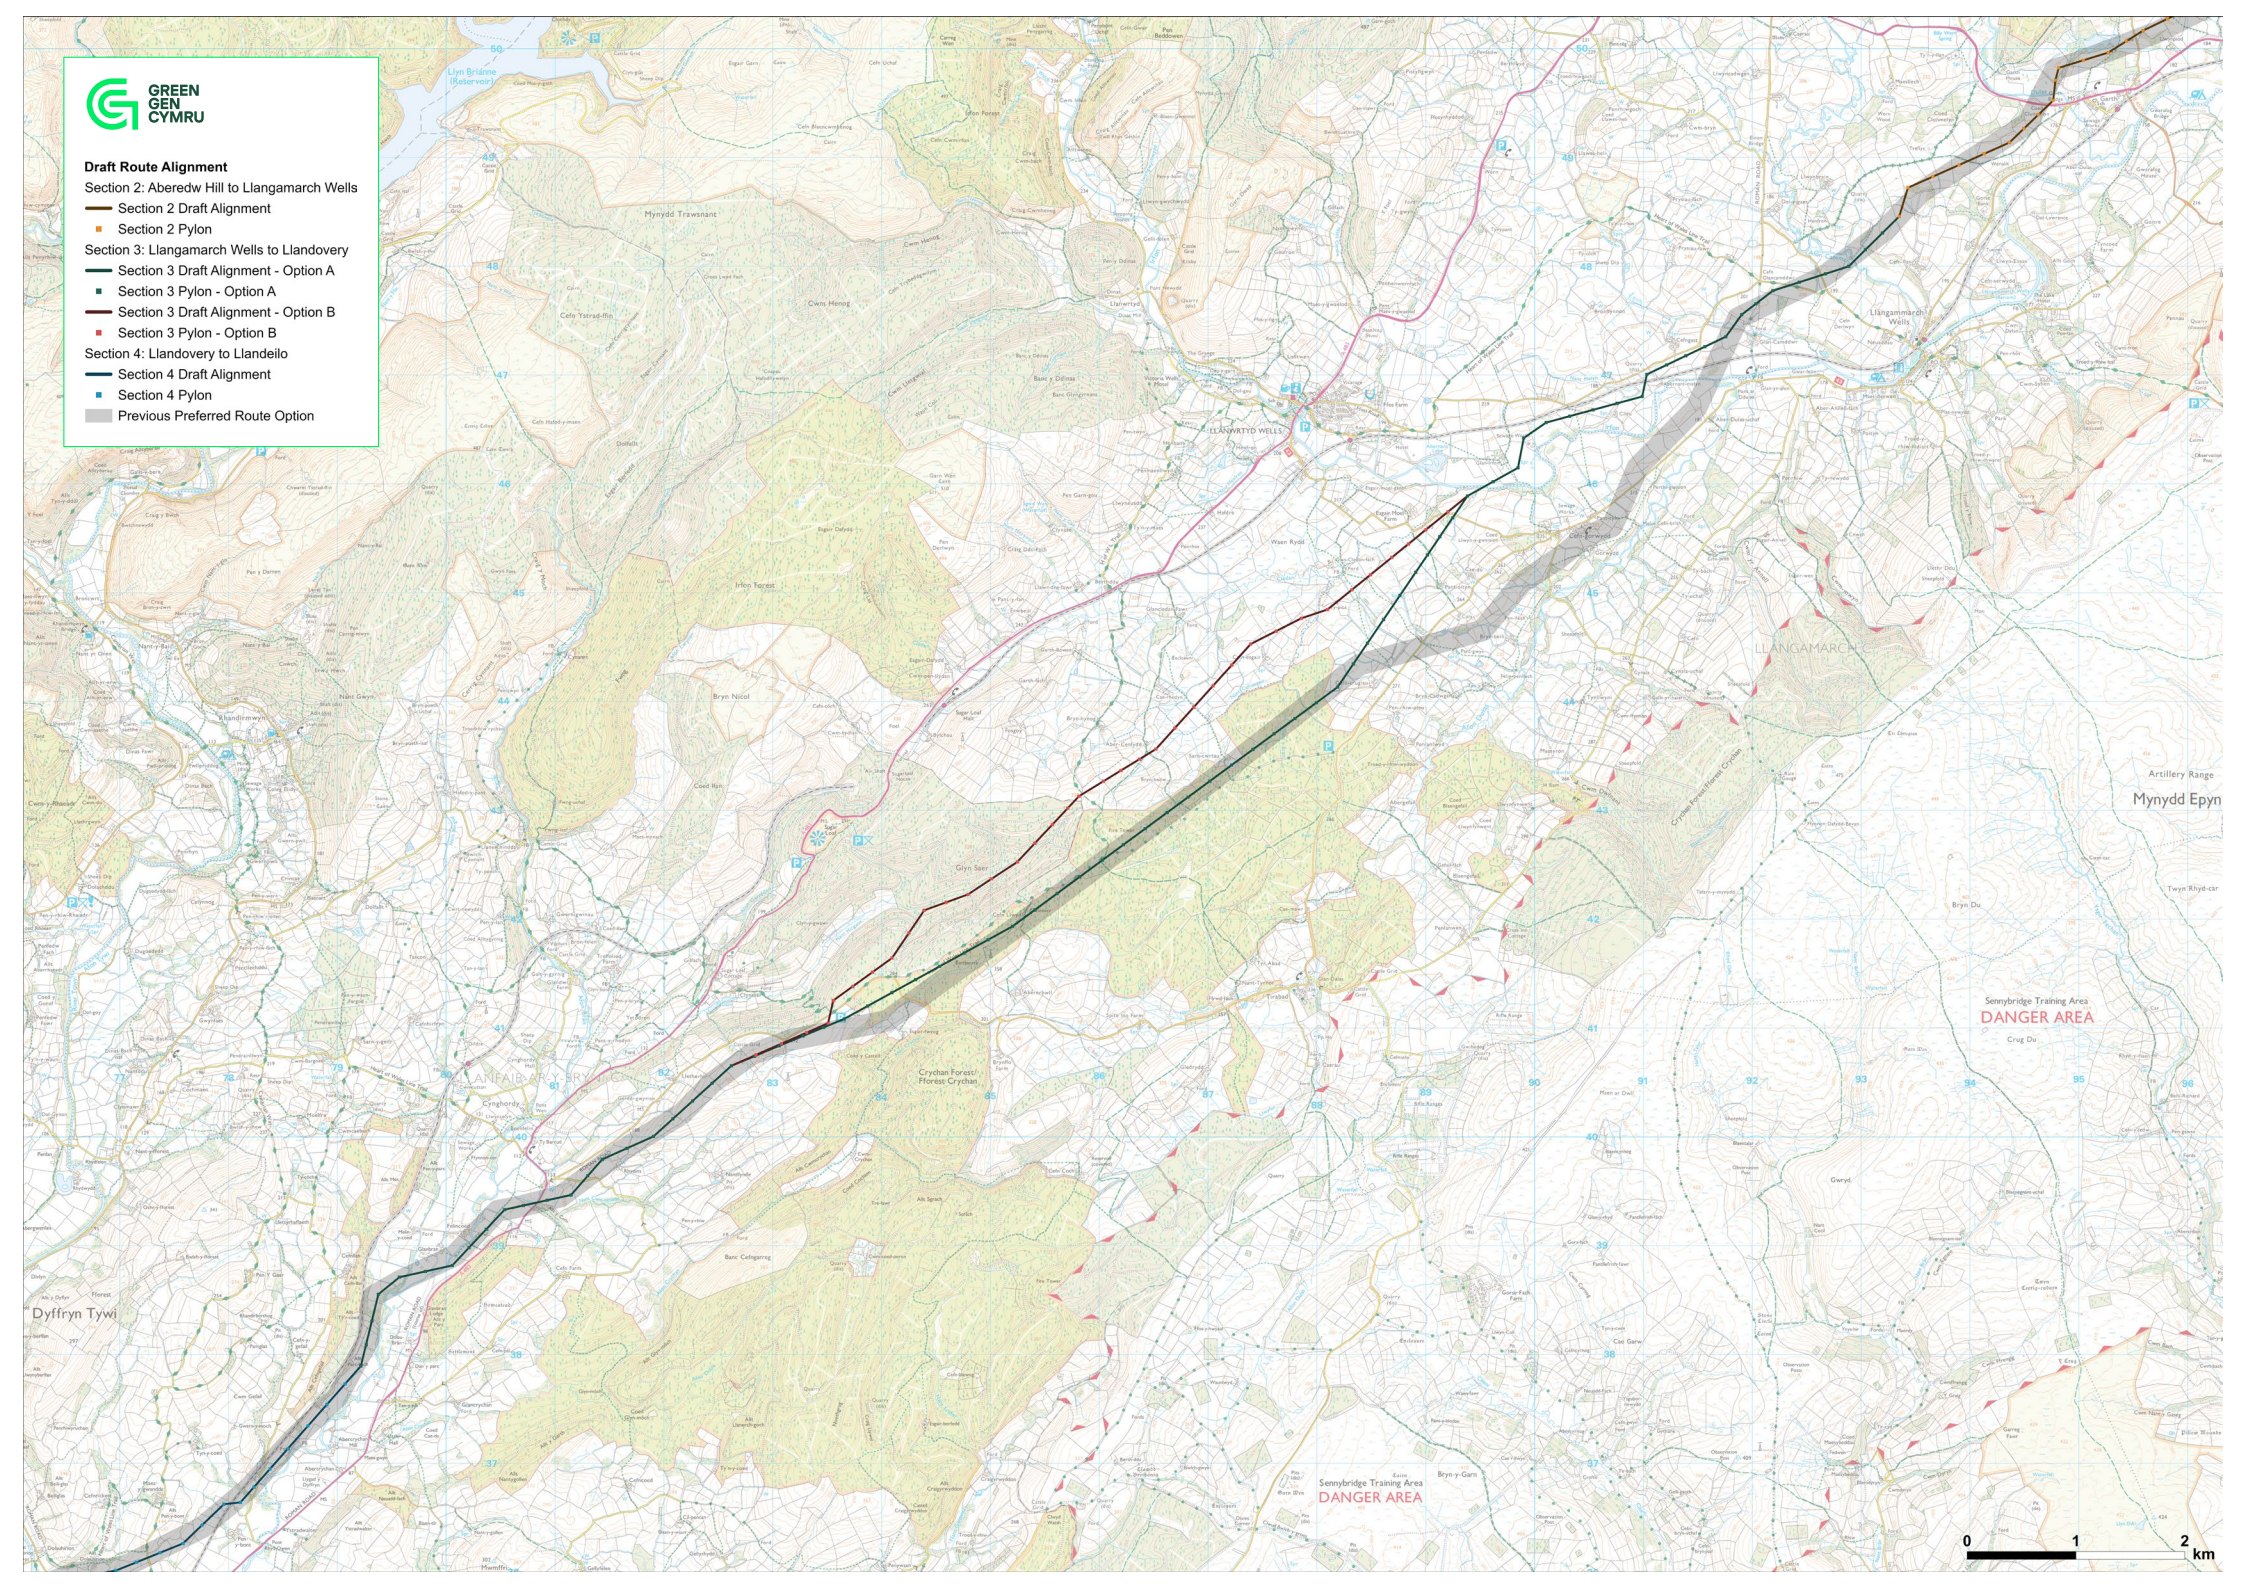



- Section 2 Pylon
- Section 3: Llangamarch Wells to Llandovery
- Section 3 Draft Alignment - Option A
- Section 3 Pylon - Option A
- Section 4: Llandovery to Llandeilo
- Section 4 Draft Alignment
- Section 4 Pylon
- Section 5: Llandeilo to Llandyfaelog
- Section 5 Draft Alignment
- Section 5 Pylon
- Previous Preferred Route Option

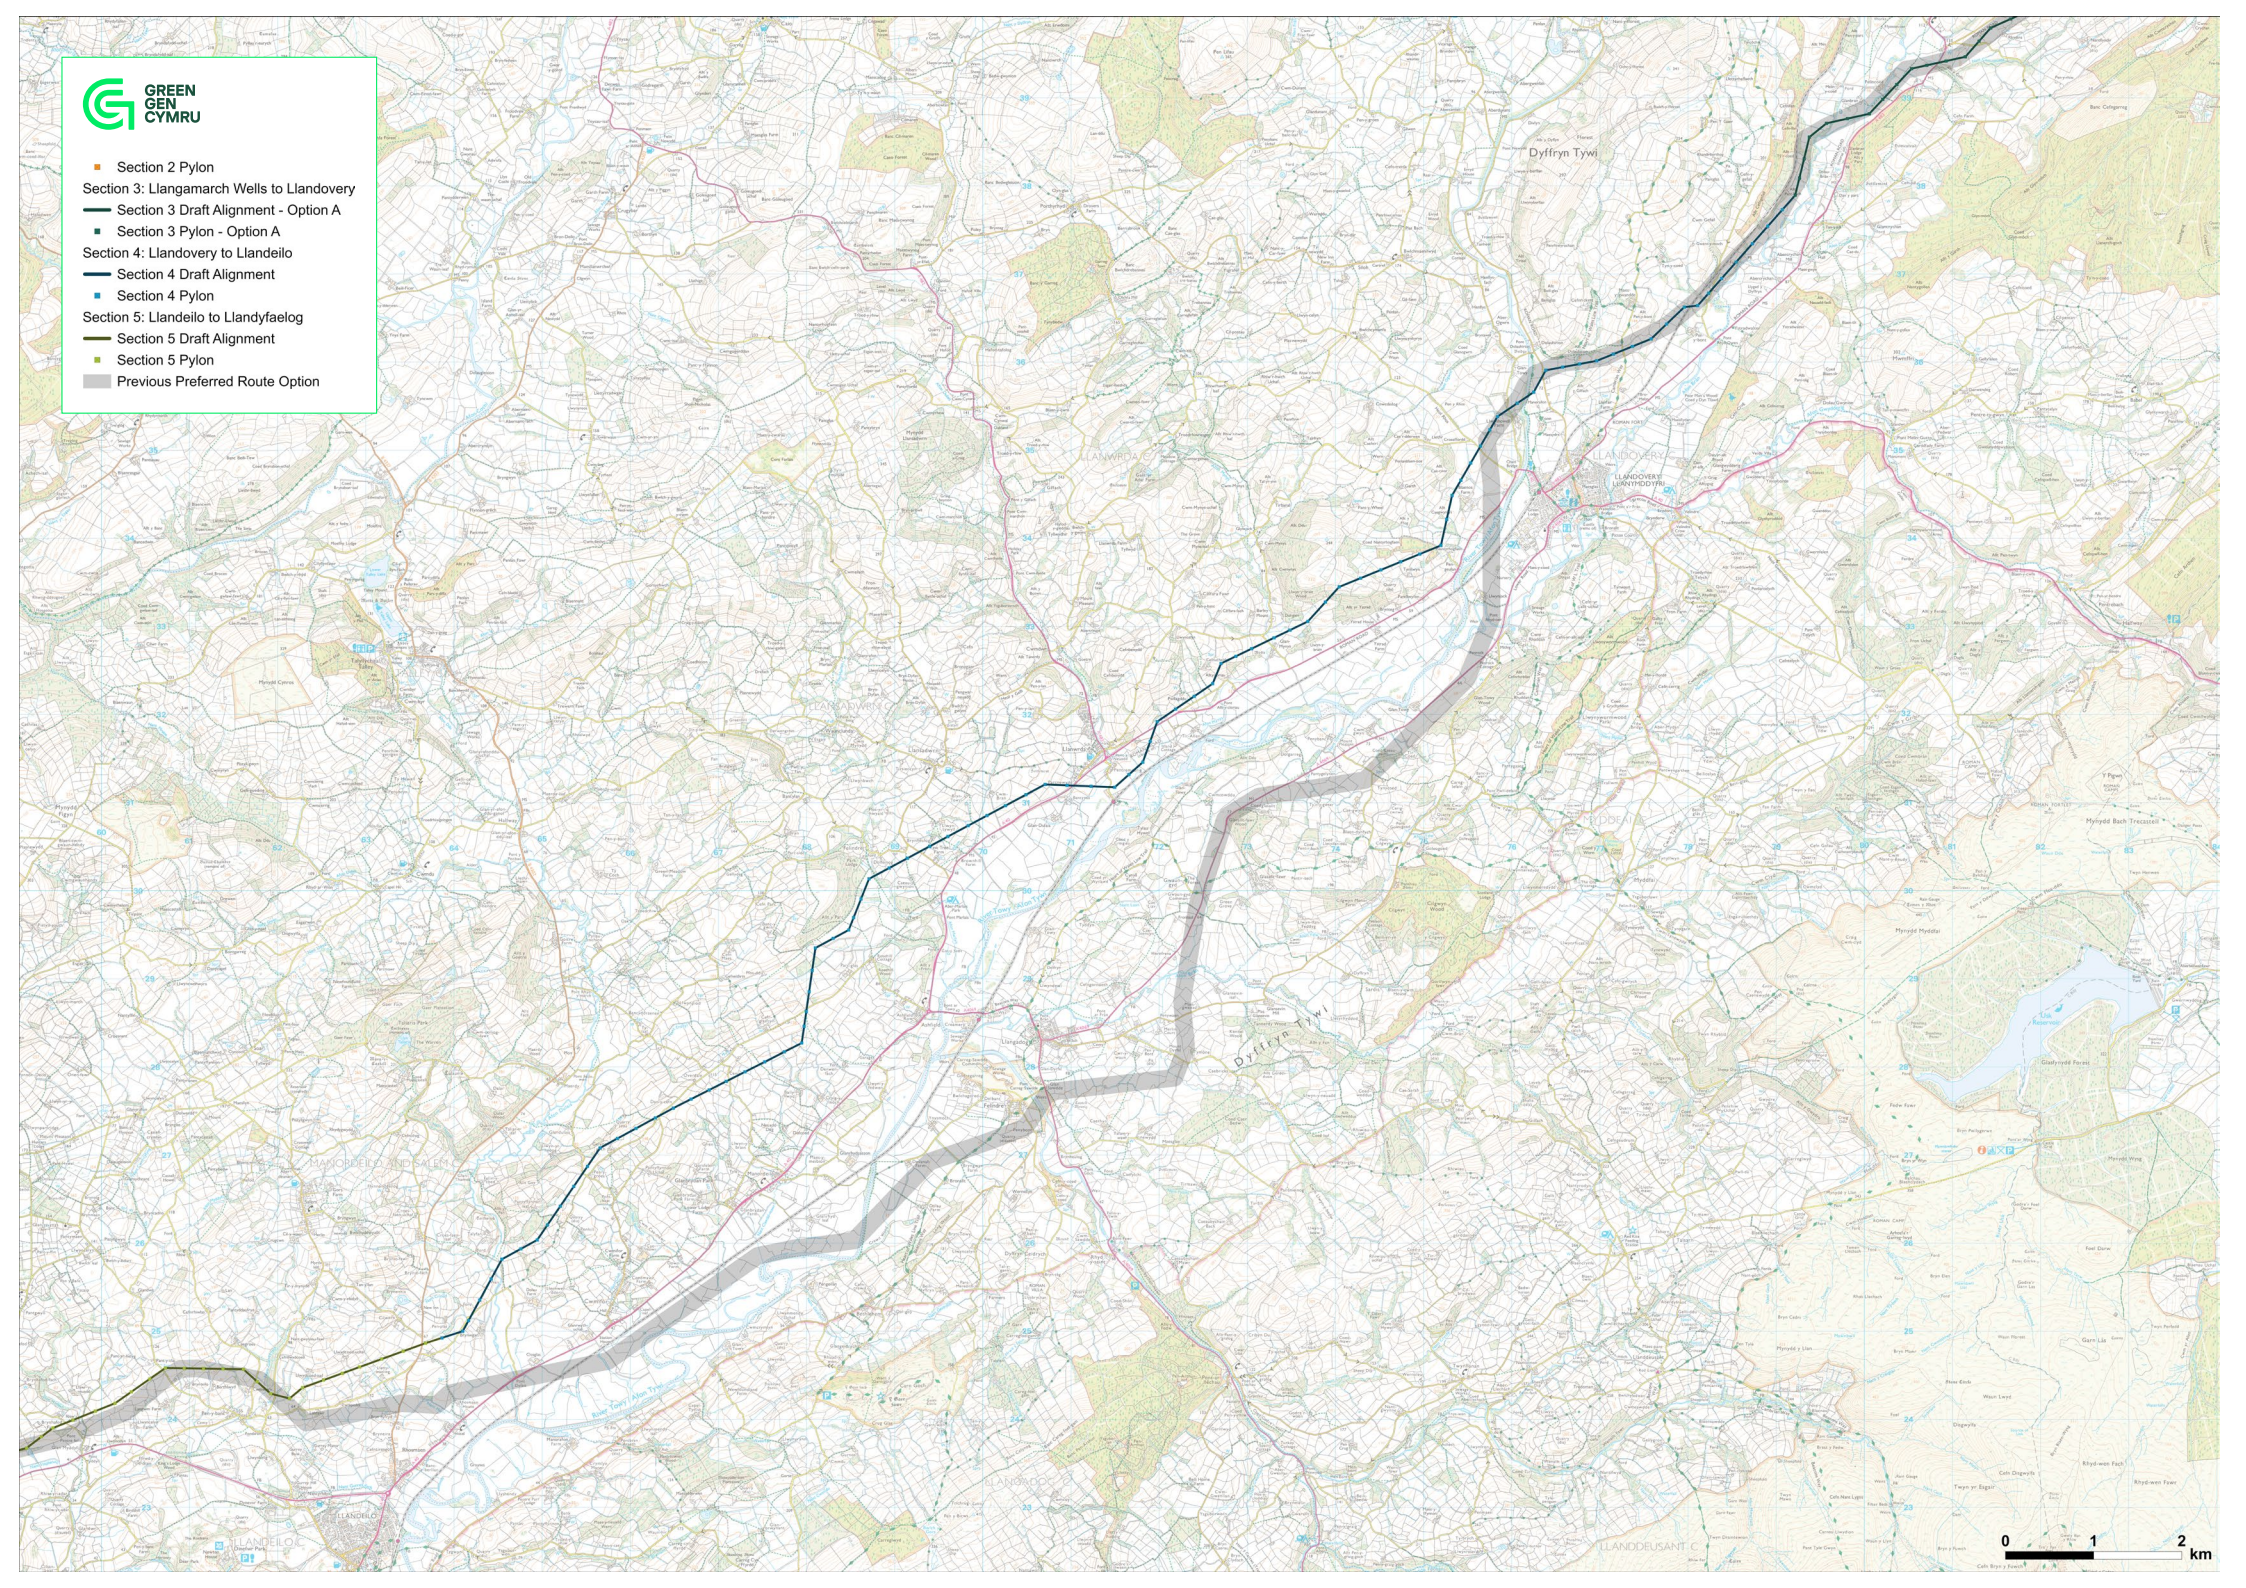



Draft Route Alignment

Section 4: Llandovery to Llandeilo

— Section 4 Draft Alignment

■ Section 4 Pylon

Section 5: Llandeilo to Llandyfaelog

— Section 5 Draft Alignment

- - - Section 5 Proposed Underground Cabling Alignment

■ Section 5 Pylon

■ Substation Siting Area

■ Previous Preferred Route Option

